


Horizon Power Metering Drawings are a standard. Metering, Terminal and Communications panels, and their layouts are not to be altered in any installation without the written approval of the Senior Metering Technician

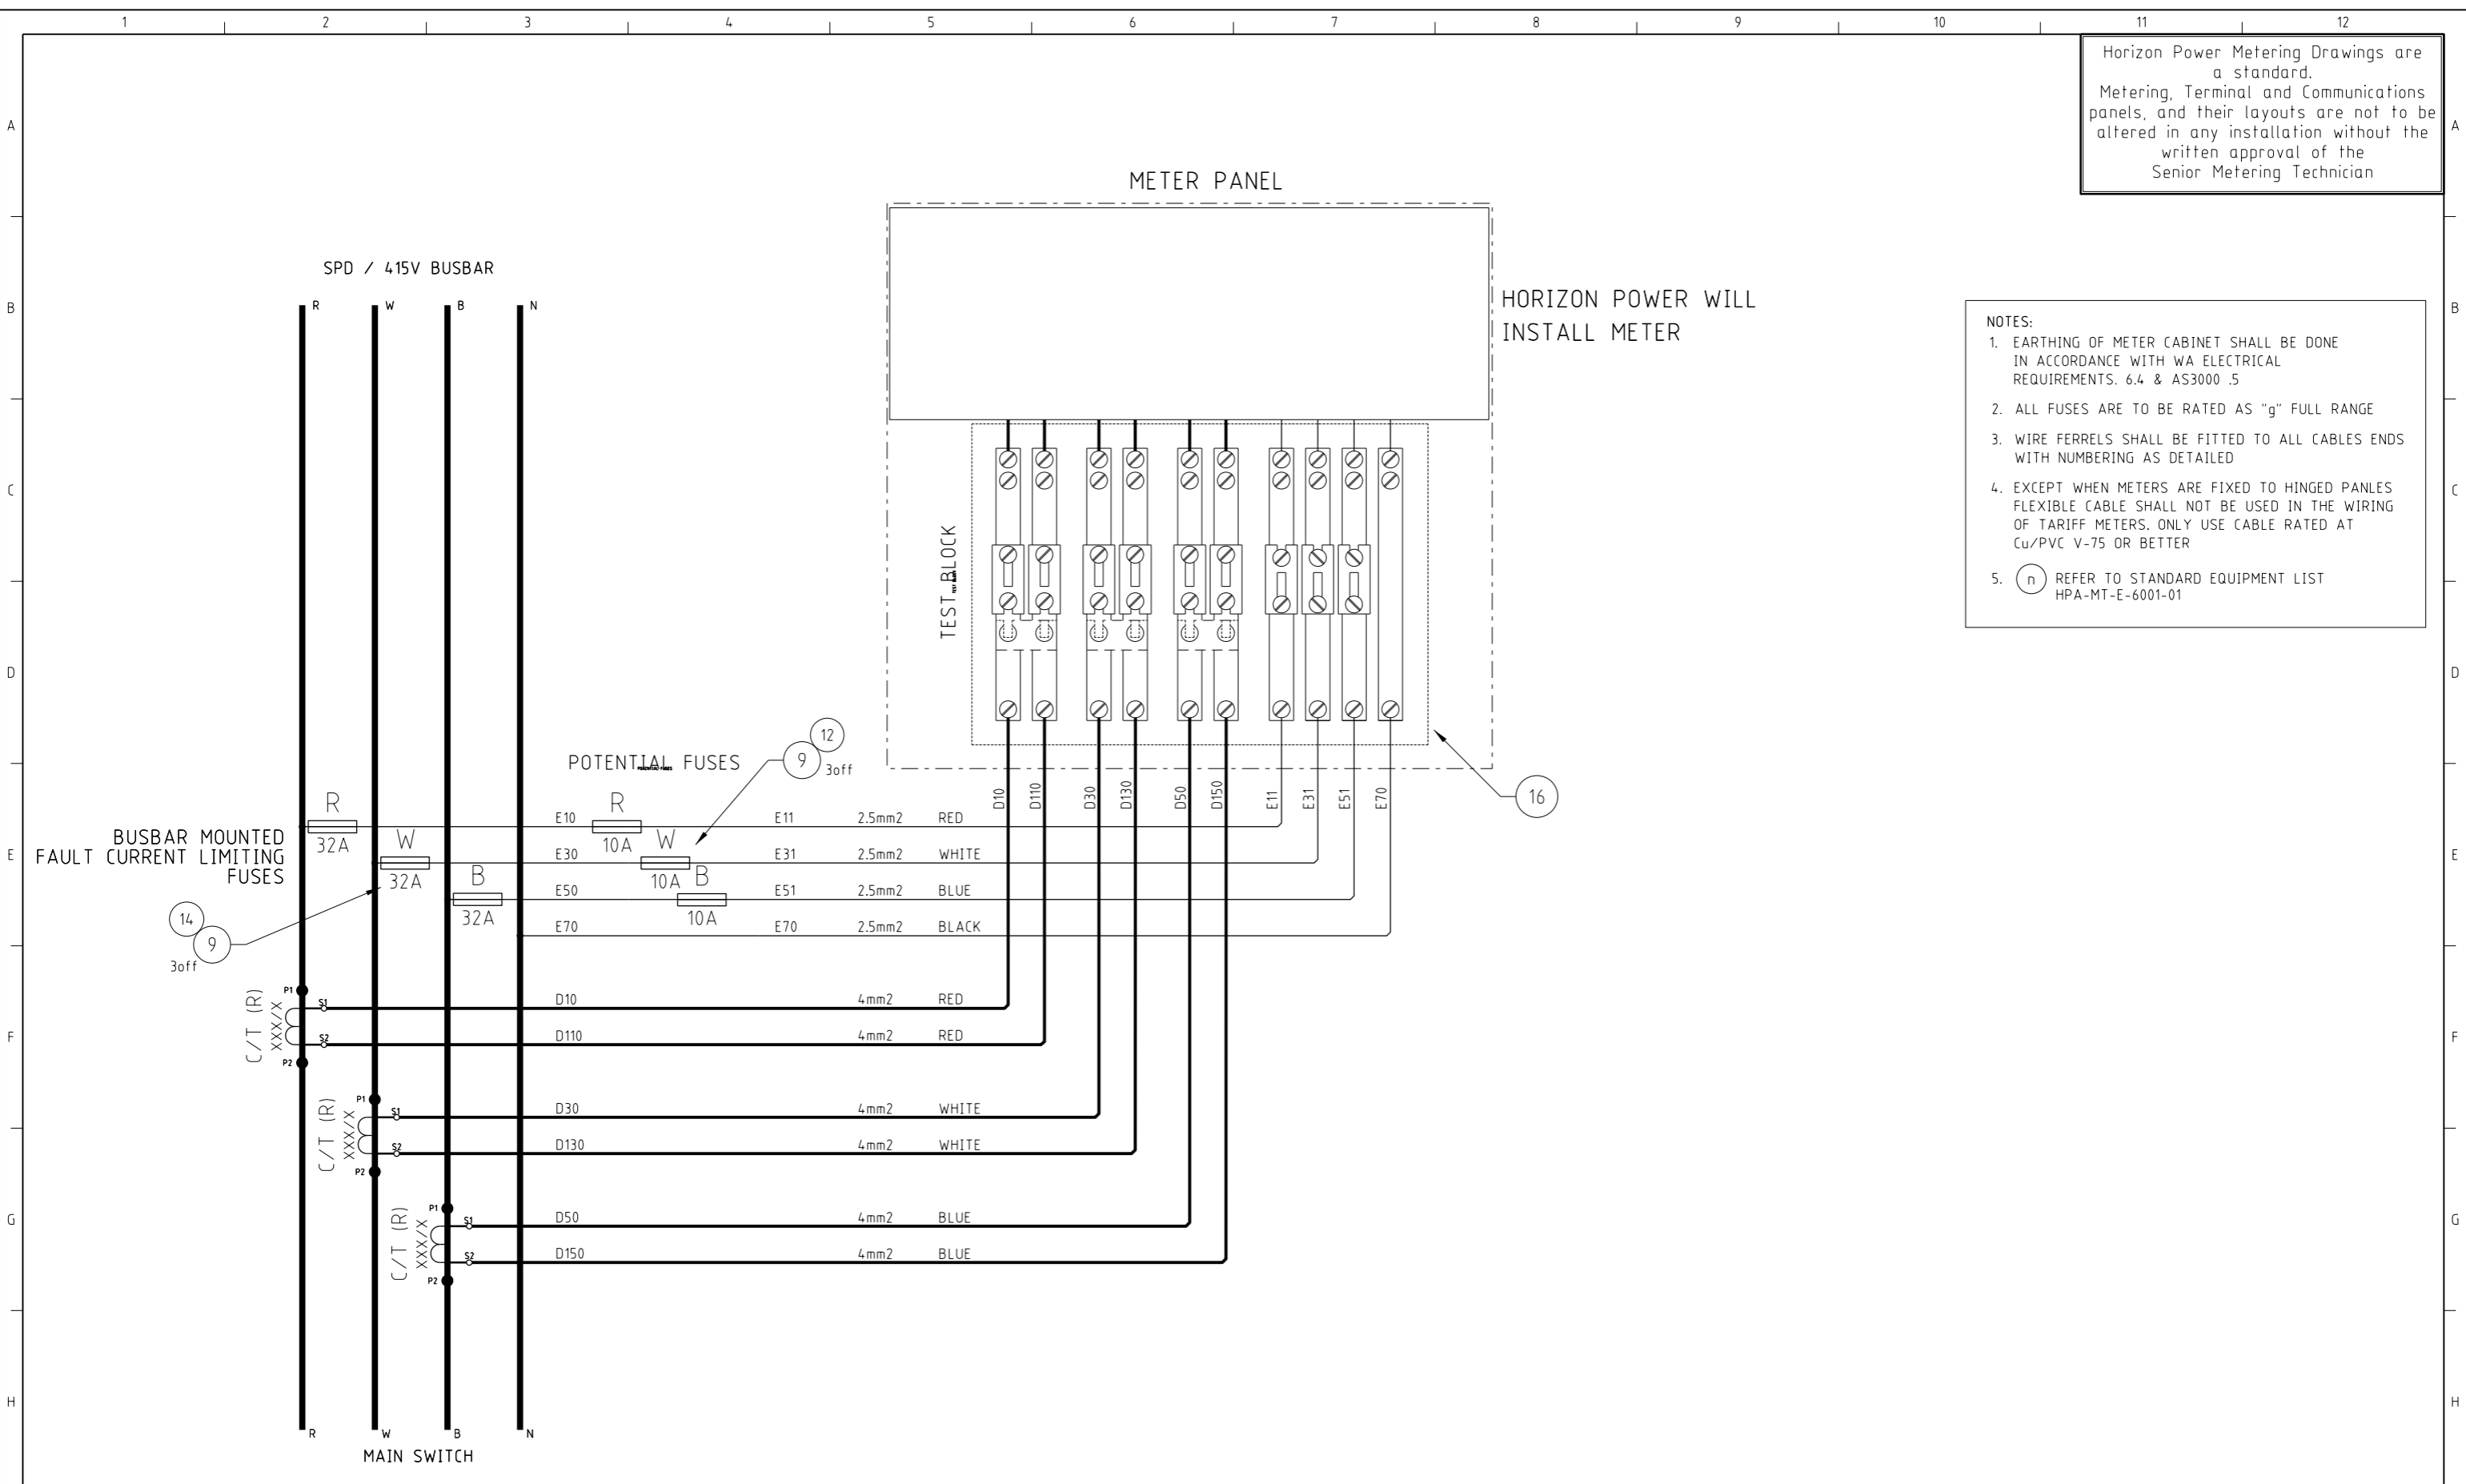

- NOTES:**
- EARTHING OF METER CABINET SHALL BE DONE IN ACCORDANCE WITH WA ELECTRICAL REQUIREMENTS. 6.4 & AS3000.5
 - ALL FUSES ARE TO BE RATED AS "g" FULL RANGE
 - WIRE FERRELS SHALL BE FITTED TO ALL CABLE ENDS WITH NUMBERING AS DETAILED
 - EXCEPT WHEN METERS ARE FIXED TO HINGED PANLES FLEXIBLE CABLE SHALL NOT BE USED IN THE WIRING OF TARIFF METERS. ONLY USE CABLE RATED AT Cu/PVC V-75 OR BETTER
 - REFER TO STANDARD EQUIPMENT LIST HPA-MT-E-6001-01

REV	DATE	REVISION DESCRIPTION	DRN	CHK'D	DES'D	DES APP'D	APP'D
A	21.07.25	ISSUED FOR REVIEW FOR NX002207, DTK-479	BP	BP	RA	DR	DR

HORIZON POWER JOB / FILE No:		
DRN:	B.PATEL	21.07.25
CHK'D:	B.PATEL	21.07.25
DES:	R.AYLETT	21.07.25
DES APP'D:	D.RAVAL	21.07.25
APP'D:	D.RAVAL	21.07.25

HORIZON POWER
METERING
WIRING DIAGRAM
LV CT METERING STANDARD
EXTERNAL

HORIZON POWER

DRAWING NUMBER: HPA-MT-E-4001-04

REV: A

SCALE: NTS SHEET: 04 SIZE: A3

DATE: 7/21/2025 10:19:10 AM BY: H181195